



Anderson County

Building & Codes Department


401 E. River Street, Anderson, SC 29624 • (864) 260-4158 • Fax (864) 260-4795

Handrail Grip Size Requirements As Outlined In the 2018 International Residential Code (IRC)

R311.7.8.5 Handrail Grip Size

Required handrails shall be of one of the following types or provide equivalent graspability.

(Type I) Handrails with a circular cross section shall have an outside diameter of at least 1 ¼ inches and not greater than 2 inches. If the handrail is not circular it shall have a perimeter dimension of at least 4 inches and not greater than 6 ¼ inches with a maximum cross section dimension of 2 ¼ inches.

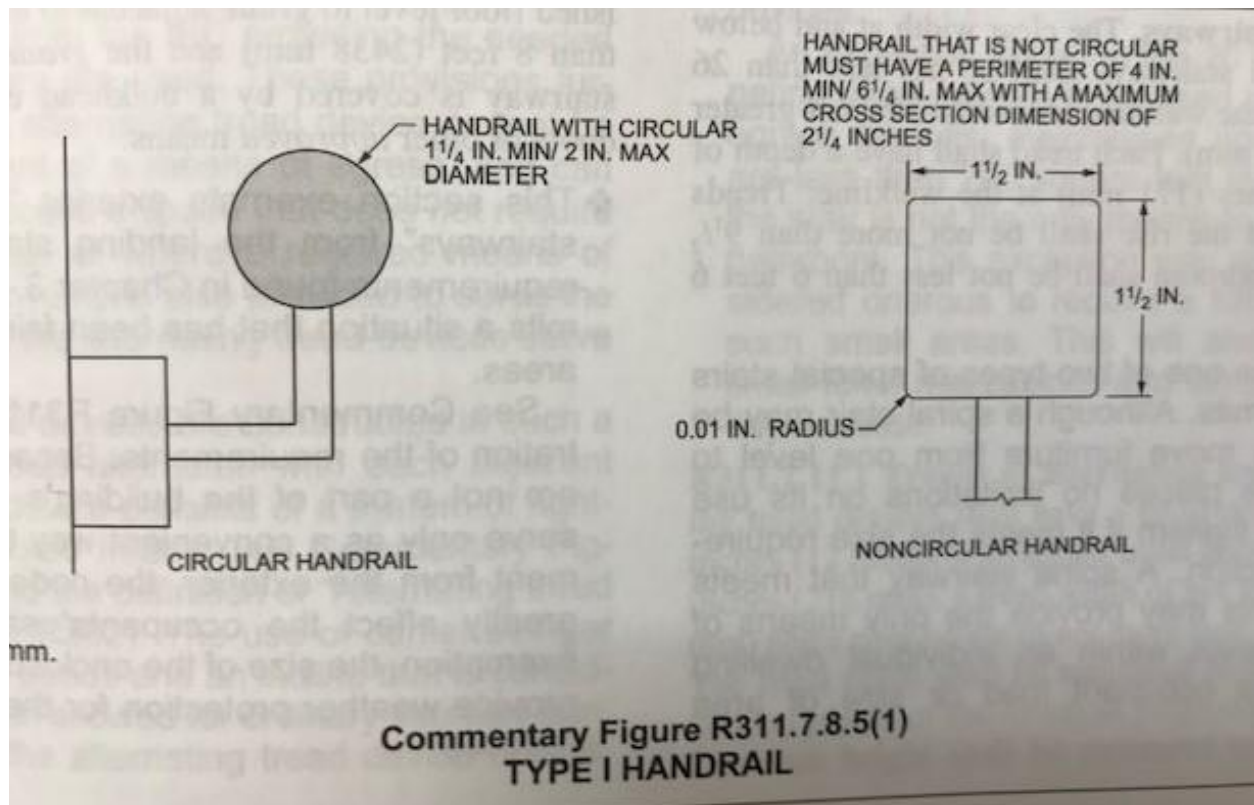

Accredited by the
American Public
Works Association

Member of the Anderson County Public Works Division

(Type II) Handrails with a perimeter greater than $6\frac{1}{4}$ inches shall provide a graspable finger recess area on both sides of the profile. The finger recess shall begin within a distance of $\frac{3}{4}$ inch measured vertically from the tallest portion of the profile and achieve a depth of at least $\frac{5}{16}$ inch within $\frac{7}{8}$ inch below the widest portion of the profile. This required depth shall continue for at least $\frac{3}{8}$ inch to a level that is not less than $1\frac{3}{4}$ inches below the tallest portion of the profile. The minimum width of the handrail above the recess shall be $1\frac{1}{4}$ inches to a maximum of $2\frac{3}{4}$ inches. Edges shall have a minimum radius of 0.01 inches.

